


Control Box Replacement Parts

Complete Control Box


If your filtration system control box has been hit by lightning or has incurred irreparable damage, we can replace the entire box. Each control box is virtually unique, so call us with your system serial number for a quote on price and delivery.

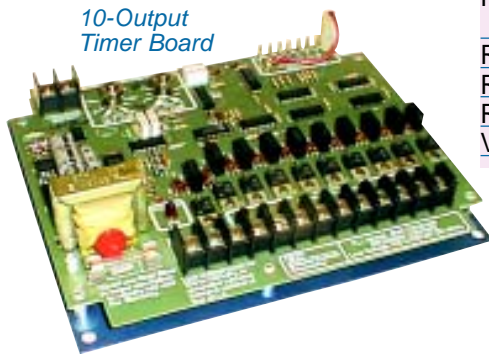

10-Output
Timer Board

Control Box Replacement Parts

Component	Part Number	Comments
Timer Board	P12-5888	115VAC, 10 outputs
Timer Board	P15-6458	115VAC, 32 outputs
Timer Board	P13-5057	24VDC, 10 outputs
Relay & Socket	P12-5886	24 VDC
Pulse Cycle Counter	70174-01	formerly P14-4555
Fuse	P13-2582	3 amp
Fuse	P13-5223	2 amp
Fuse	P13-9675	1 amp
Fuse	P13-5712	1/4 amp
Fuse	80857-28	60 amp
Power Supply	P13-5216	115/230 VAC input, 24 VDC/2.5amp output
Relay	45862-01	24 VDC/2PDT, latching style
Relay	P13-5047	24 VDC/3PDT, #KUP14D15
Relay	P14-6849	120V #KUP14A15
Voltage Regulator	P13-5247	24 VDC input/ 24 VDC/3amp output

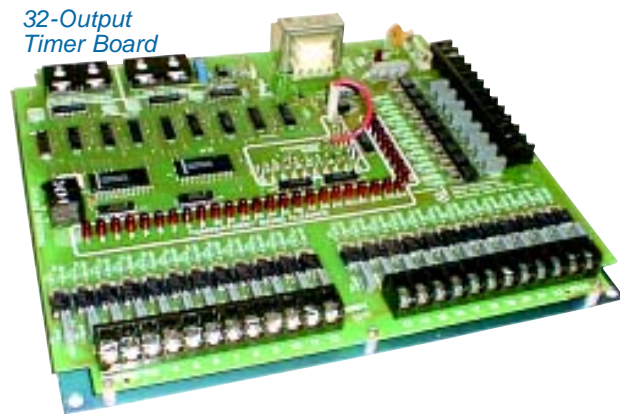

32-Output
Timer Board

Clock Timers

Component	Part Number	Description
Timer, Tripper	49151-01	24 Hr, manually set
Timer, Programmable	54972-01	24 Hr, digital readout

Typically Used In:

- GDX & TTD pulse-cleaned systems to initiate pulse cleaning at specified times of day.

Programmable
Clock Timer



Tripper Clock Timer

